



## DRAFT FIRE HYDRANT DETAIL (FROM TANK)

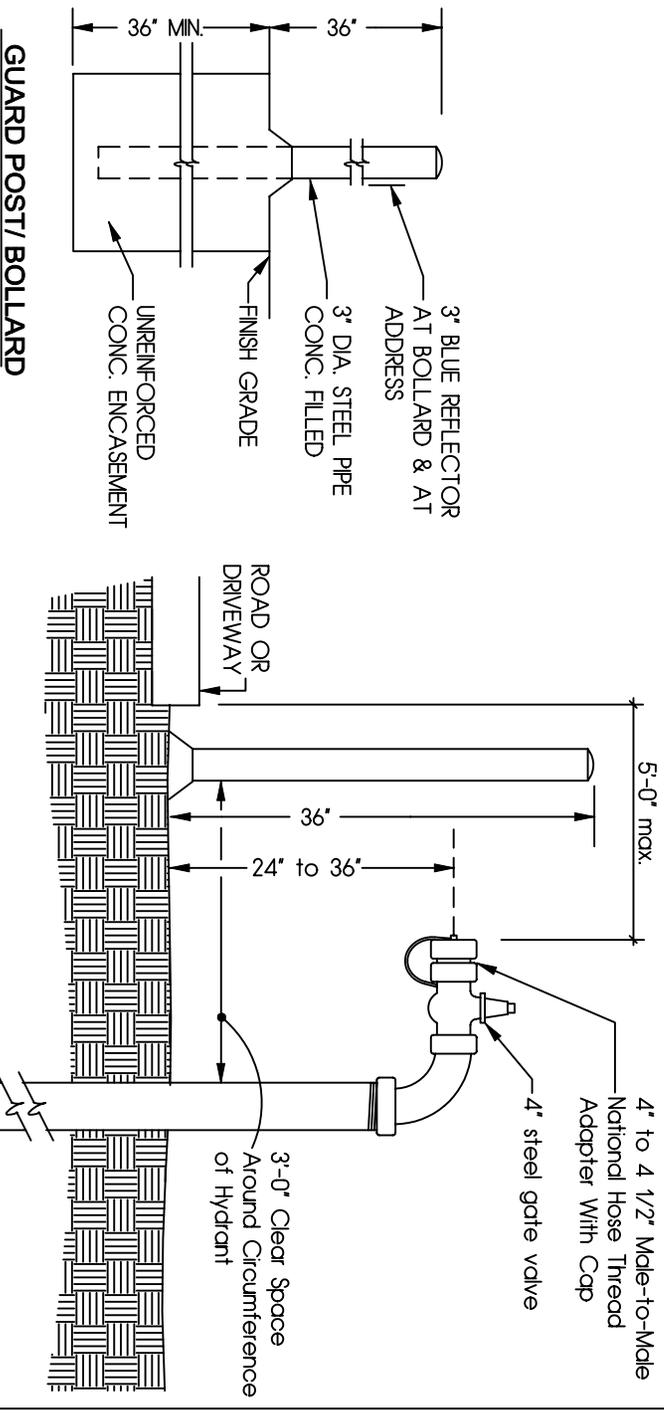

### FIRE HYDRANT NOTES

- Show location of fire hydrant connection located within 150 feet of residence but no closer than 30 feet.
- Hydrant shall not be obscured by vegetation or structures.
- Water storage required for domestic purposes shall be in addition to the required storage for fire protection and all pipes or valves required for domestic purposes shall be installed on the tank above the level domestic purposes only.
- A 3 inch blue dot reflector shall be located adjacent to Hydrant.
- Fire hydrant connection shall be located within 5 feet of the driveway. Hydrant shall be located to so as not to block egress and ingress to and from the residence. Provide a turnout at that location if needed.
- Fire hydrant shall be painted red and signage (12" x 18", min.) posted on it to read "Wet Draft Hydrant" 3' letters "White".

### HYDRANT & BOLLARD TYPICAL SPACING



## DRAFT FIRE HYDRANT DETAIL

ST. HELENA FIRE DEPARTMENT

1480 MAIN STREET  
ST. HELENA, CALIFORNIA 94574  
FIRE DEPT. TELEPHONE (707) 967-2880 FAX (707) 963-7057  
CITY HALL TELEPHONE (707) 967-2792 FAX (707) 963-7748

FIRE SAFE STANDARDS

3/4" = 1'-0"

SCALE

REVISION DATE

MAY 15, 2009

**7**

DRAWING NO. 1